


序号	名称	单位	材料要求	数量	备注
1	顶棚通气管	个		360.17	6.6 附
	其中 净高超过 2.2m 时	个		64.25	6.6 2.2m 时
2	总工程量	元		2722.89	
	其中 顶棚通气管	个		168.95	2
	顶棚通气管	个		718.64	2
	顶棚通气管	个		417.00	2
	顶棚通气管	个		44.47	1
	顶棚通气管	个		61.62	1
	总工程量	元		1061.55	
	其中 顶棚通气管	个		45.16	2
	顶棚通气管	个		226.60	2
	顶棚通气管	个		241.72	2
3	其中 顶棚通气管	个		57.69	1
	顶棚通气管	个		62.46	1
4	净高	个		0.80	
5	净高	个		29.03	



    上海外灘 100 號 上海外灘 100 號	☐ 明安堂 ☐ 明安堂 ☐ 明安堂 ☐ 明安堂	    上海外灘 100 號 上海外灘 100 號
---	---	---

[illegible]

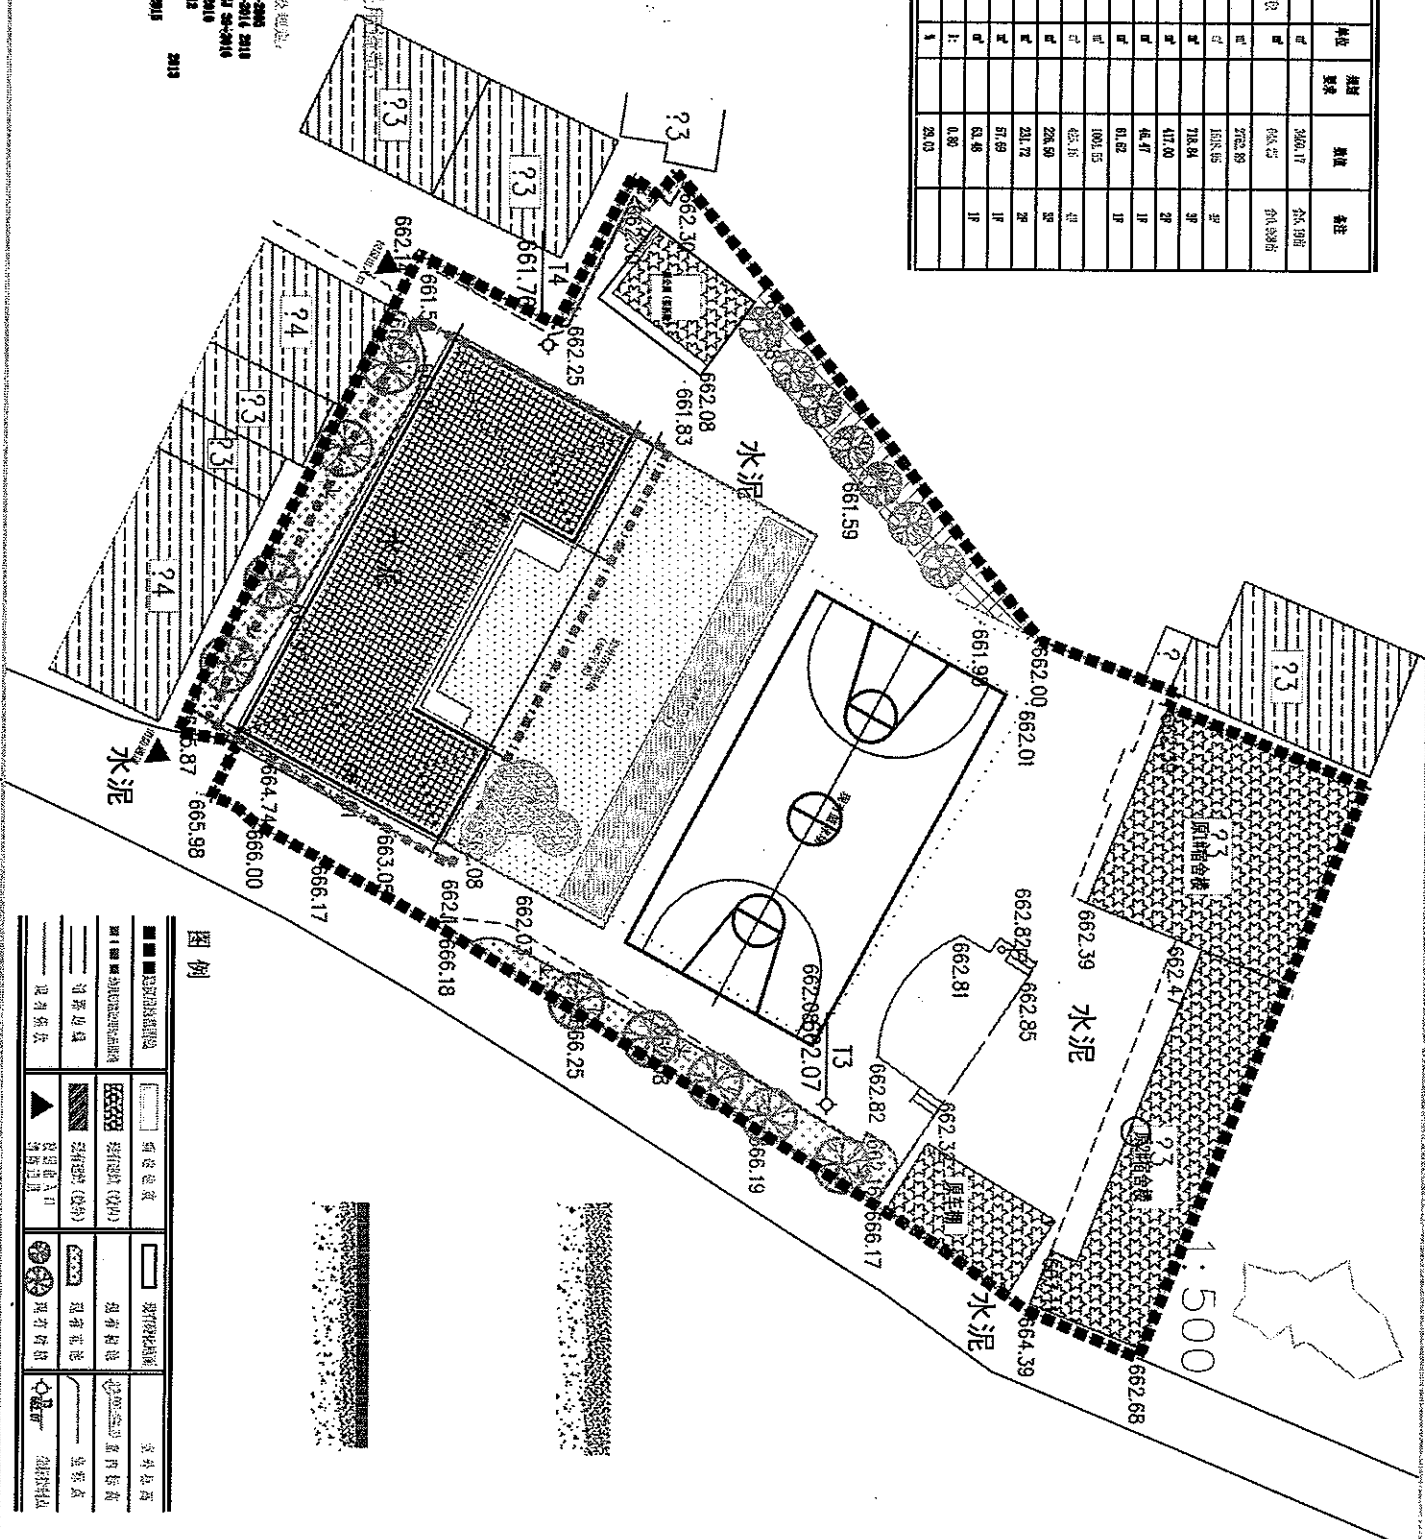